



Front view

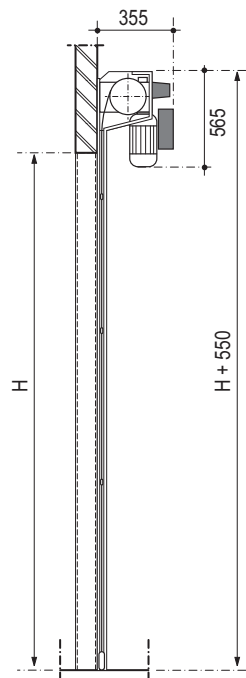


Side view




Section A

Section B

Minimum requirement for installation

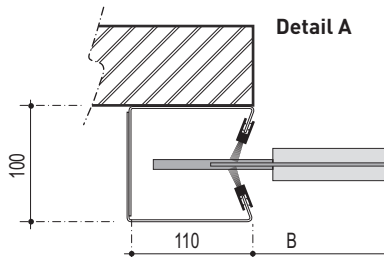

Detail A

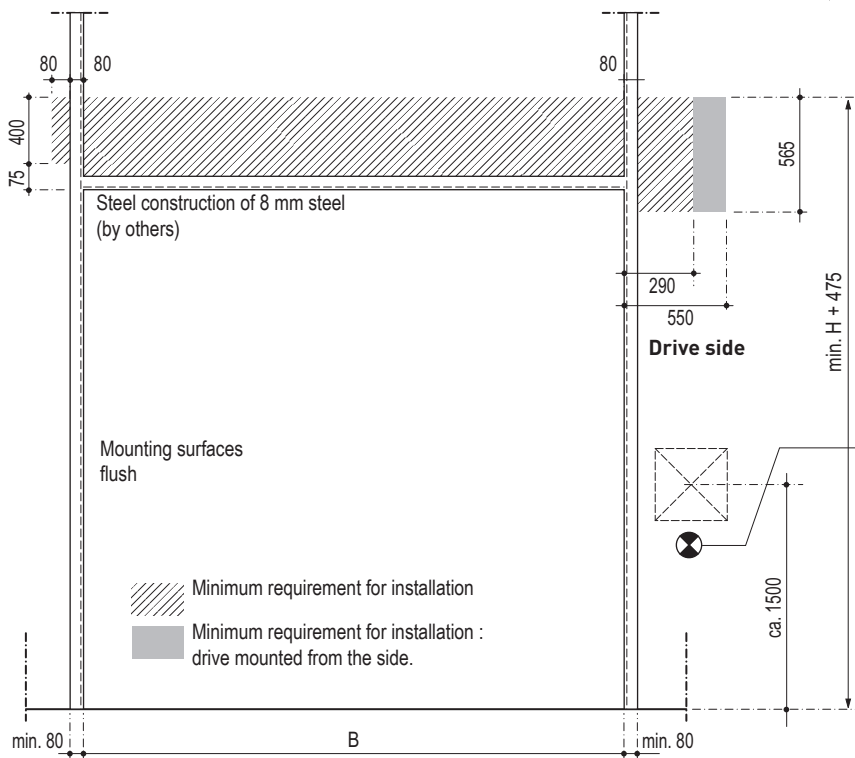

Mounting surfaces flush

Minimum requirement for installation

Minimum requirement for installation : drive mounted from the side.

Drive side

Control box with contactors :

CEE-form 3~N PE 400V/50Hz/16A

Control box with frequency inverter :

CEE-form 1x230V/50Hz/T16A

Electrical supply by others

control box/ power supply, inside RIGHT

control box/ power supply, inside LEFT

Installation requirements

